

SOUTHERN NEVADA BUILDING OFFICIALS
REGIONAL STANDARDS

P-101
7-7-14
PG. 1 OF 1


LIQUIFIED PETROLEUM GAS PIPING-PROCEDURES

Clark County
Dept. of Building & Fire Prevention
4701 W Russell Rd
Las Vegas, NV 89118
(702) 455-3000

Boulder City
Building Department
401 California Avenue
Boulder City, NV 89005
(702) 293-9282

Henderson
Bldg & Fire Safety Dept.
240 Water Street
Henderson, NV 89015
(702) 267-3650

Las Vegas
Building & Safety Dept.
333 N. Rancho Drive
Las Vegas, NV 89106
(702) 229-6251

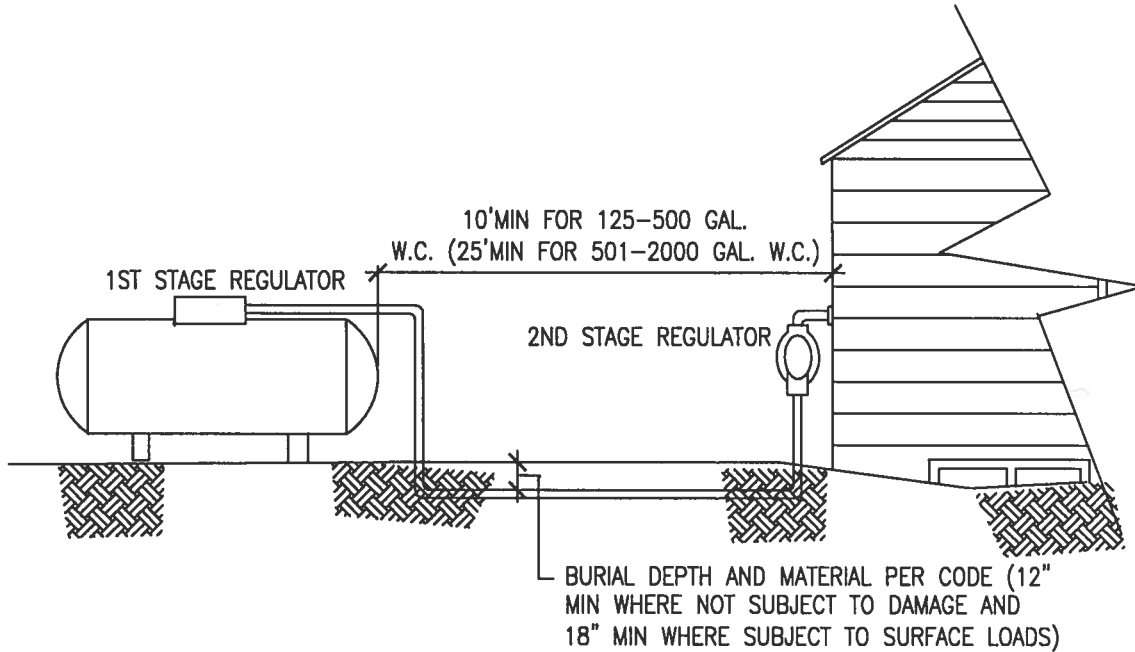

PERMIT APPLICATION WITH PLANS SHALL GIVE SCOPE OF WORK IN COMPLIANCE WITH APPLICABLE CODES.

PLANS SHALL SHOW LENGTH OF PIPE, FIXTURE DEMANDS IN BTU AND PIPE SIZES.

INSPECTIONS SHALL BE REQUESTED FOR UNDERGROUND ROUGH AND FINAL INSTALLATIONS IN ACCORDANCE WITH THE SCOPE OF WORK DEFINED BY PERMIT AND APPROVED PLANS.

NOTE: L.P. TANK IS NOT REQUIRED TO BE SET BEFORE INSPECTION OF PIPING IS GIVEN AND GAS TAG ISSUED.

NOTE: TANK PLACEMENT AND LOCATION SHALL BE APPROVED BY THE CODE OFFICIAL.

INSPECTIONS SHALL OBSERVE PRESSURE TEST ON PIPING FROM OUTLET SIDE OF 1ST STAGE REGULATOR AND OUTLET SIDE OF 2ND STAGE REGULATOR. FIRST STAGE OUTLET PRESSURE, MINIMUM 60 PSI. SECOND STAGE OUTLET PRESSURE, MINIMUM 10 PSI.

NOTE: IN SOME INSTALLATIONS A HIGH/LOW (PIGGYBACK) REGULATOR MAY BE INSTALLED AT THE TANK IN LIEU OF SEPARATE REGULATORS AT THE TANK AND THE RESIDENCE. IN THIS CASE THE PRESSURE TEST WILL BE A MINIMUM OF 10 PSI AT THE TANK REGULATOR LOCATION. PRESSURE TEST VERIFICATION SHALL BE MADE AT THE FINAL INSPECTION. MUST CONFORM TO NFPA 58-2012, 54-2012 AND 2012 UMC.

Mesquite
Building Department
10 East Mesquite Blvd.
Mesquite, NV 89027
(702) 346-2835

North Las Vegas
Building Department
2250 Las Vegas Blvd. N
N. Las Vegas, NV 89030
(702) 633-1577

Pahrump
Building & Fire Safet Dept.
250 N Hwy 160 Suite #3
Pahrump, NV 89060
(775) 751-3373

Clark County School District
Building Department
4190 McLeod Drive, 1st Floor
Las Vegas, NV 89121
(702) 799-7605